


# 三喜運輸株

外気温が一番高かった8/5の比較  
 南面：室温Aと室温Eの温度差：約9℃

クールサーム施工期間：2025年4月19日～2025年5月2日 面積：屋根 1,107㎡、外壁 586㎡

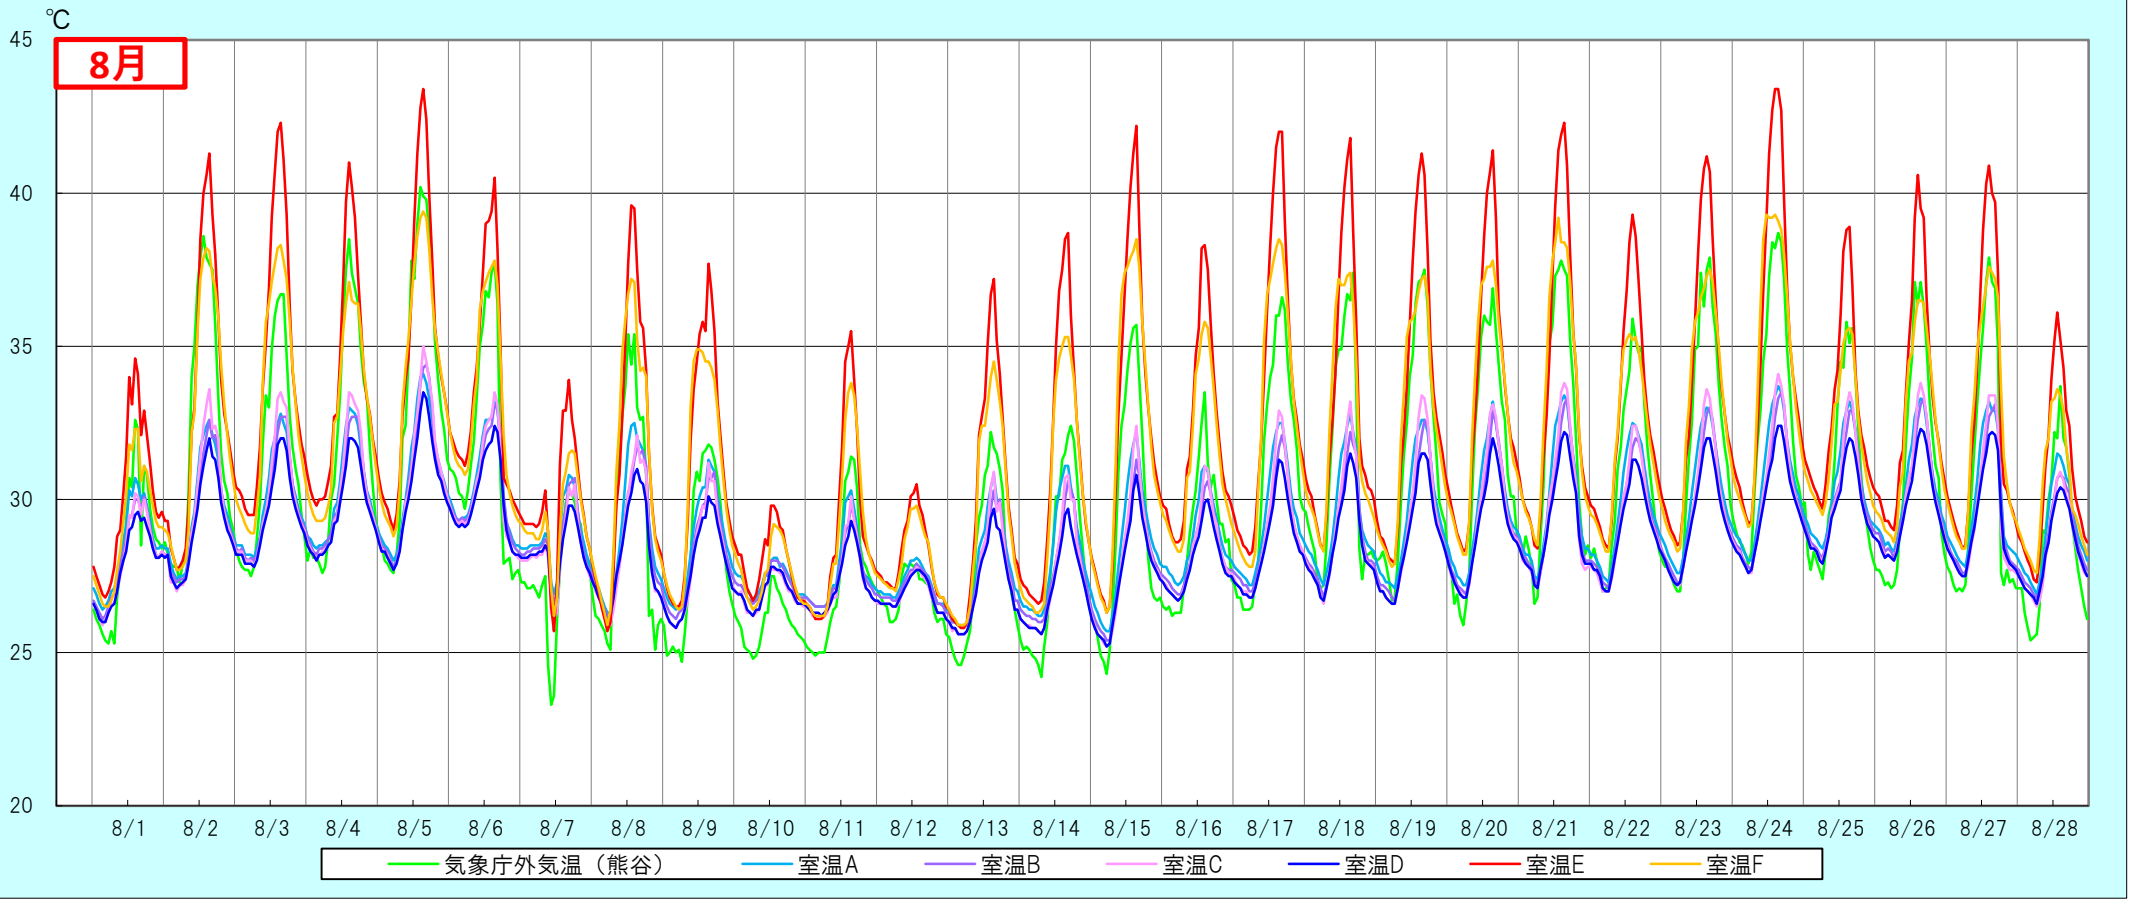

最高温度	8/1	8/2	8/3	8/4	8/5	8/6	8/7	8/8	8/9	8/10	8/11	8/12	8/13	8/14	8/15	8/16	8/17	8/18	8/19	8/20	8/21	8/22	8/23	8/24	8/25	8/26	8/27	8/28	
天気	☁/☔	☀/☁	☀	☁/☀	☀	☁/☔	☔/☁	☀/☁	☀/☁	☔	☁/☔	☔	☁/☀	☁/☀	☀	☁	☀	☀	☀	☀/☁	☀	☁/☀	☀	☀	☁/☀	☁/☀	☀/☔	☁/☀	☀/☀
外気温(熊谷)	32.6	38.6	36.7	38.5	40.2	37.7	30.2	35.4	31.8	27.5	31.4	27.9	32.2	32.4	35.7	33.5	36.6	37.4	37.5	36.9	37.8	35.9	37.9	38.7	35.8	37.1	37.9	33.7	
室温A	30.7	32.6	32.8	33.0	34.1	33.2	30.8	32.5	31.3	28.1	30.3	28.1	30.8	31.1	32.2	31.1	32.5	32.8	32.6	33.2	33.4	32.5	33.0	33.7	33.2	33.3	33.2	31.5	
室温B	30.1	32.6	32.7	32.7	34.4	33.1	30.7	31.7	30.9	28.0	29.8	27.9	30.3	30.6	31.3	30.6	32.1	32.2	32.6	32.9	33.3	32.0	33.0	33.5	32.9	33.3	33.1	30.8	
室温C	30.2	33.6	33.5	33.5	35.0	33.5	30.5	32.1	31.2	27.8	30.1	27.8	30.9	30.8	32.4	31.1	32.9	33.2	33.4	33.1	33.8	32.4	33.6	34.1	33.5	33.8	33.4	30.9	
室温D	29.6	32.0	32.0	32.0	33.5	32.4	29.8	31.0	30.1	27.8	29.3	27.7	29.7	29.7	30.8	30.0	31.3	31.5	31.5	32.0	32.2	31.3	32.0	32.4	32.0	32.3	32.2	30.4	
室温E	34.6	41.3	42.3	41.0	43.4	40.5	33.9	39.6	37.7	29.8	35.5	30.5	37.2	38.7	42.2	38.3	42.0	41.8	41.3	41.4	42.3	39.3	41.2	43.4	38.9	40.6	40.9	36.1	
室温F	32.3	38.2	38.3	37.1	39.4	37.8	31.6	37.2	34.9	29.2	33.8	29.8	34.5	35.3	38.5	35.8	38.5	37.4	37.3	37.8	39.2	35.4	37.5	39.3	35.6	36.5	37.6	33.6	